



UPS Cabinet




Input Cord
Line Cord 6-50P (8ft)

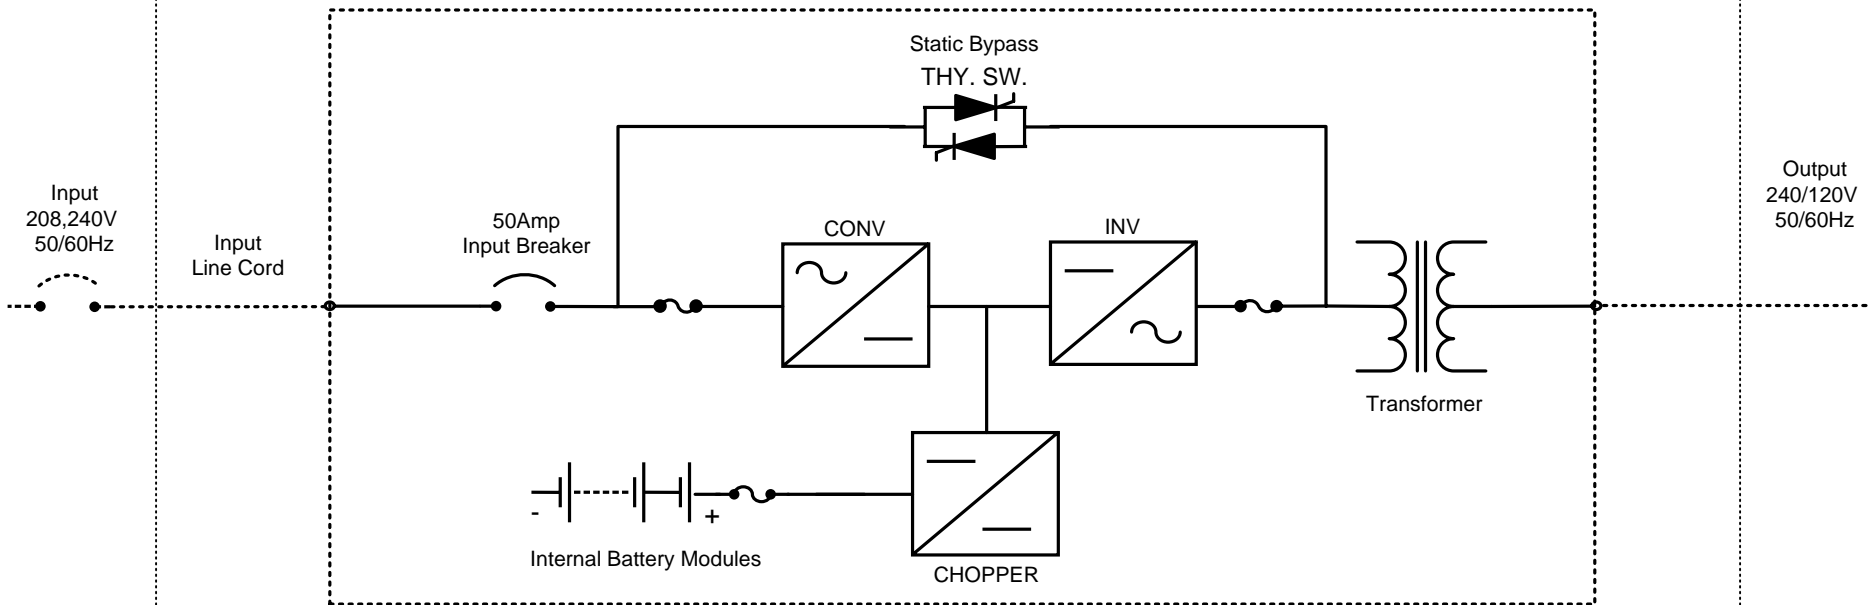

Wiring Diagram

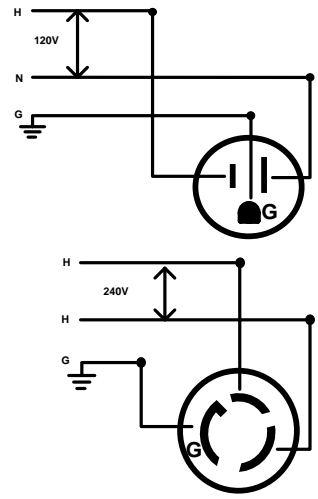

Output Receptacle Panel

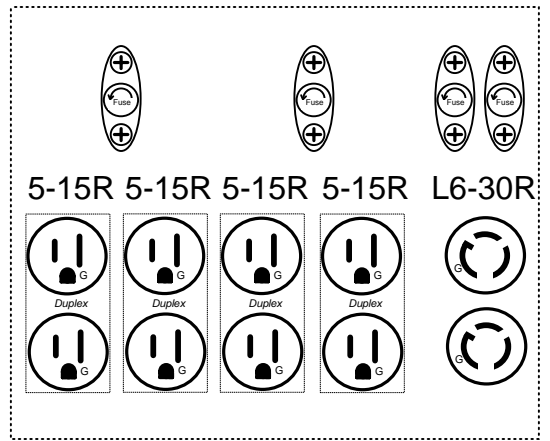

NOTES

1. 5-15R Has 15 Amp 600V Fuse
2. Each L6-30R Has (1) 30 Amp 600V Fuse

DRAWN BY	DATE
JE	10/13/05
APPROVED	DATE
GM	10/13/05

TOSHIBA
INTERNATIONAL CORPORATION
Houston Texas, USA

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF TOSHIBA INTERNATIONAL CORPORATION AND SHALL NOT BE REPRODUCED, USED, OR DISCLOSED TO OTHERS UNLESS PRIOR WRITTEN AUTHORIZATION IS OBTAINED.

TITLE	
1600 EP Series 6 kVA Model 208/240V Input 240/120V Output	
DRAWING NO.	REV.
UE3G2L060C61TPB7	1.0