
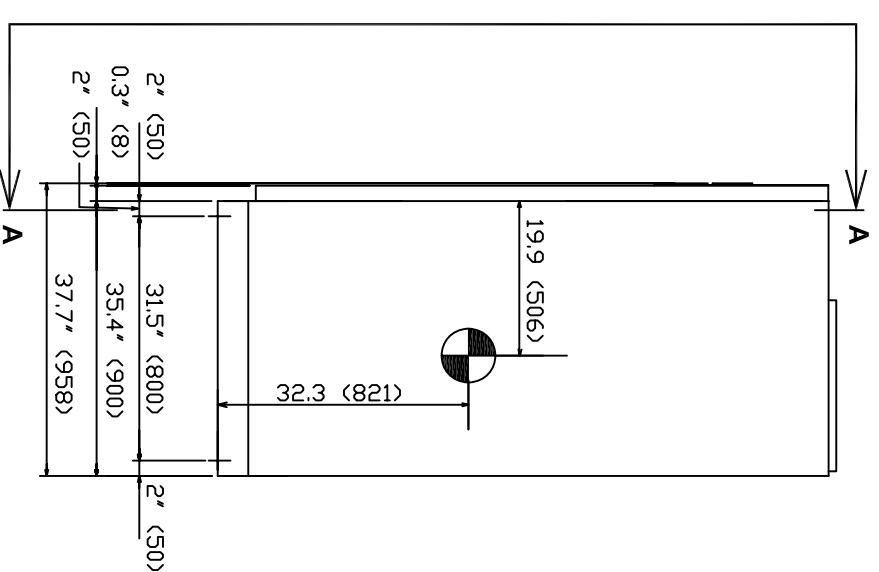
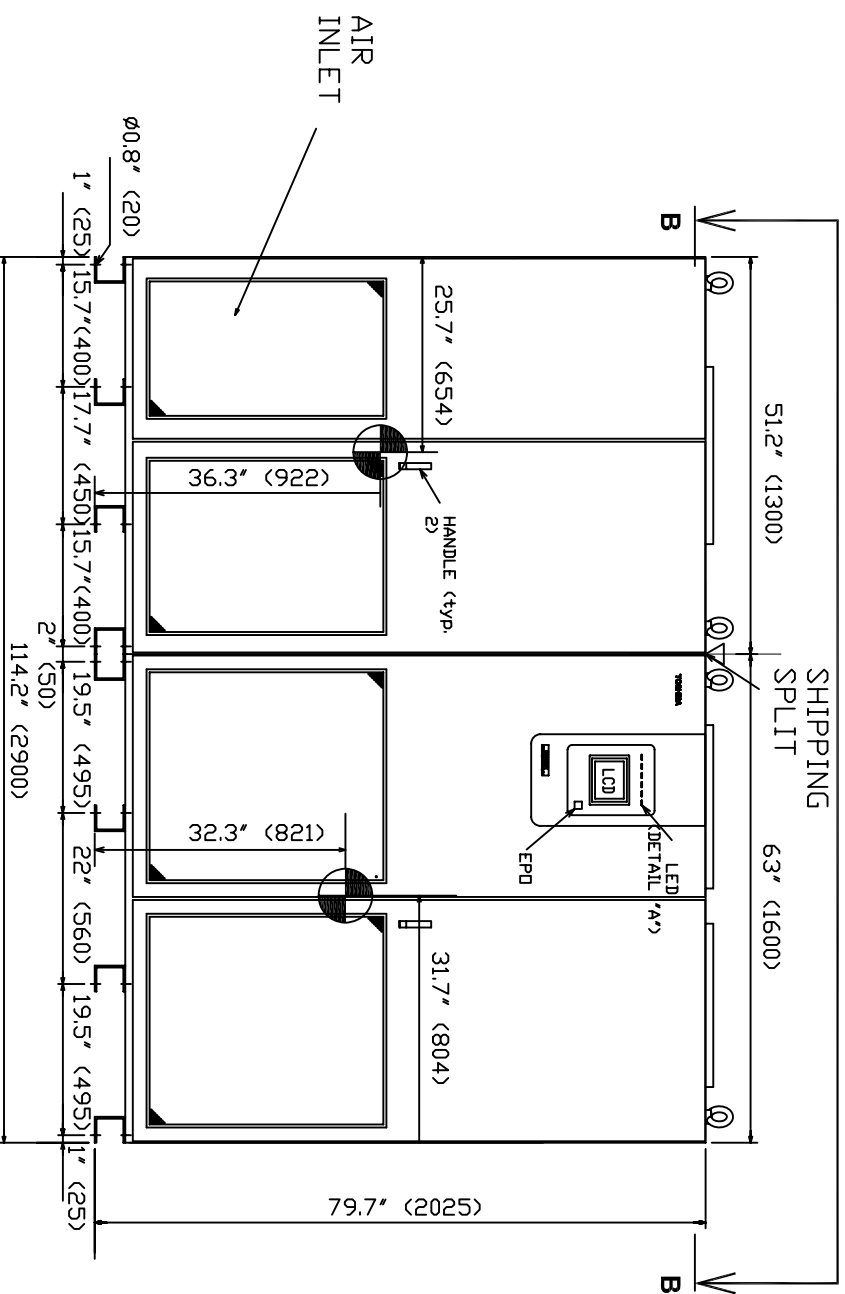
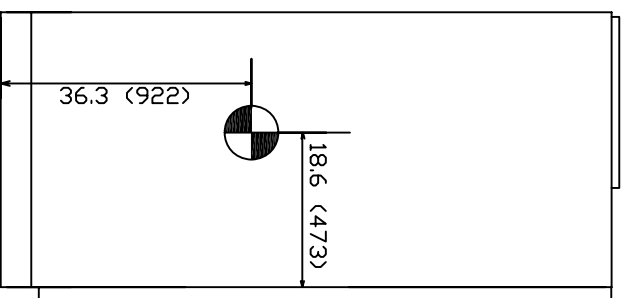
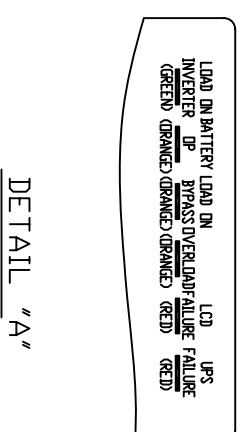


<p>NOTES</p> <p>1) This drawing is for illustration purposes only and is subject to change without notice. TIC is not responsible for any errors or omissions.</p>	<p>Drawn by EKM Date 6/04/08 Approved by</p>	<p align="center">TOSHIBA INTERNATIONAL CORPORATION Houston Texas, USA</p> <p align="center">THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF TOSHIBA INTERNATIONAL CORPORATION AND SHALL NOT BE REPRODUCED, USED, OR DISCLOSED TO OTHERS UNLESS PRIOR WRITTEN AUTHORIZATION IS OBTAINED.</p>	<p>TITLE</p> <p align="center">One-Line Diagram 500 kVA G8000MM Series UPS 480V Single Input, 480Y/277V Output</p> <table border="1"> <tr> <td data-bbox="1493 1485 1900 1549">DRAWING NO. T8MS3K50KK6XSN</td> <td data-bbox="1900 1485 2003 1549">REV. 0.0</td> </tr> </table>	DRAWING NO. T8MS3K50KK6XSN	REV. 0.0
DRAWING NO. T8MS3K50KK6XSN	REV. 0.0				

- NOTES
1. Cabinets must be maintained upright +/-10 degrees.
 2. Paint finish is color number 28Y7.7/D.3.
 3. Dimensions are inches (mm).


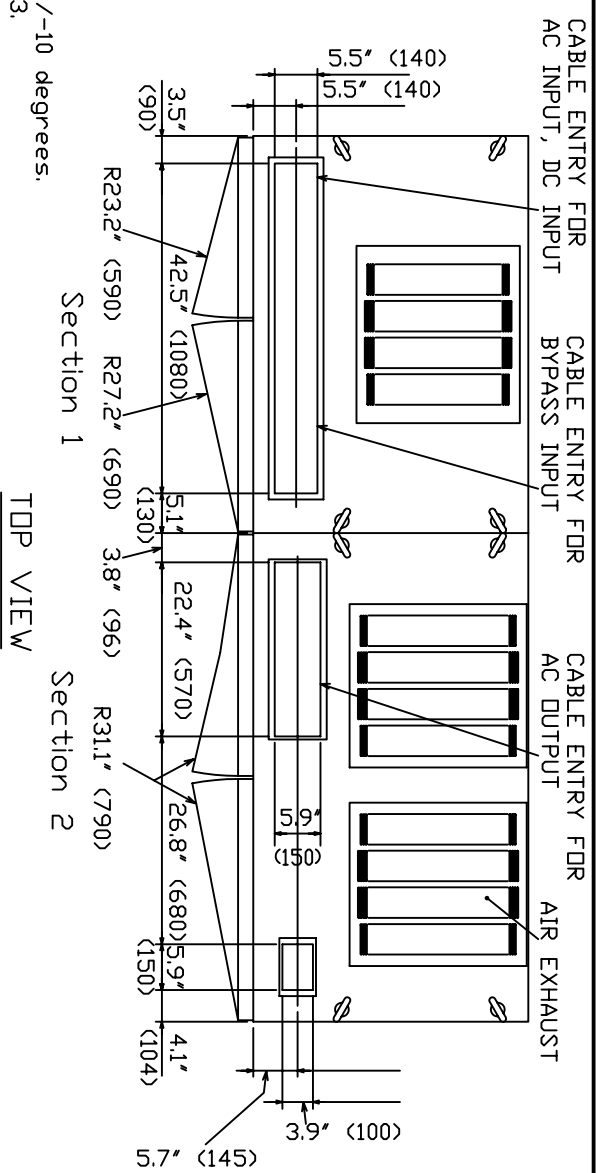


LEFT SIDE VIEW

FRONT VIEW

RIGHT SIDE VIEW

INIT RELEASE	P0	JBT	JBT	DRAWN BY:	JBT	DATE	8/27/07	THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF TOSHIBA INTERNATIONAL CORPORATION AND SHALL NOT BE REPRODUCED, USED OR DISCLOSED TO OTHERS UNLESS PRIOR WRITTEN AUTHORIZATION IS OBTAINED.	TITLE: 8000MM UPS 500kVA OUTLINE & INSTALLATION DRAWING	SCALE	NTS	ORDER NO.	50440L12-MKTG	
				CHECKED BY		DATE				DRAWING NO.				
				APPROVED BY		DATE								

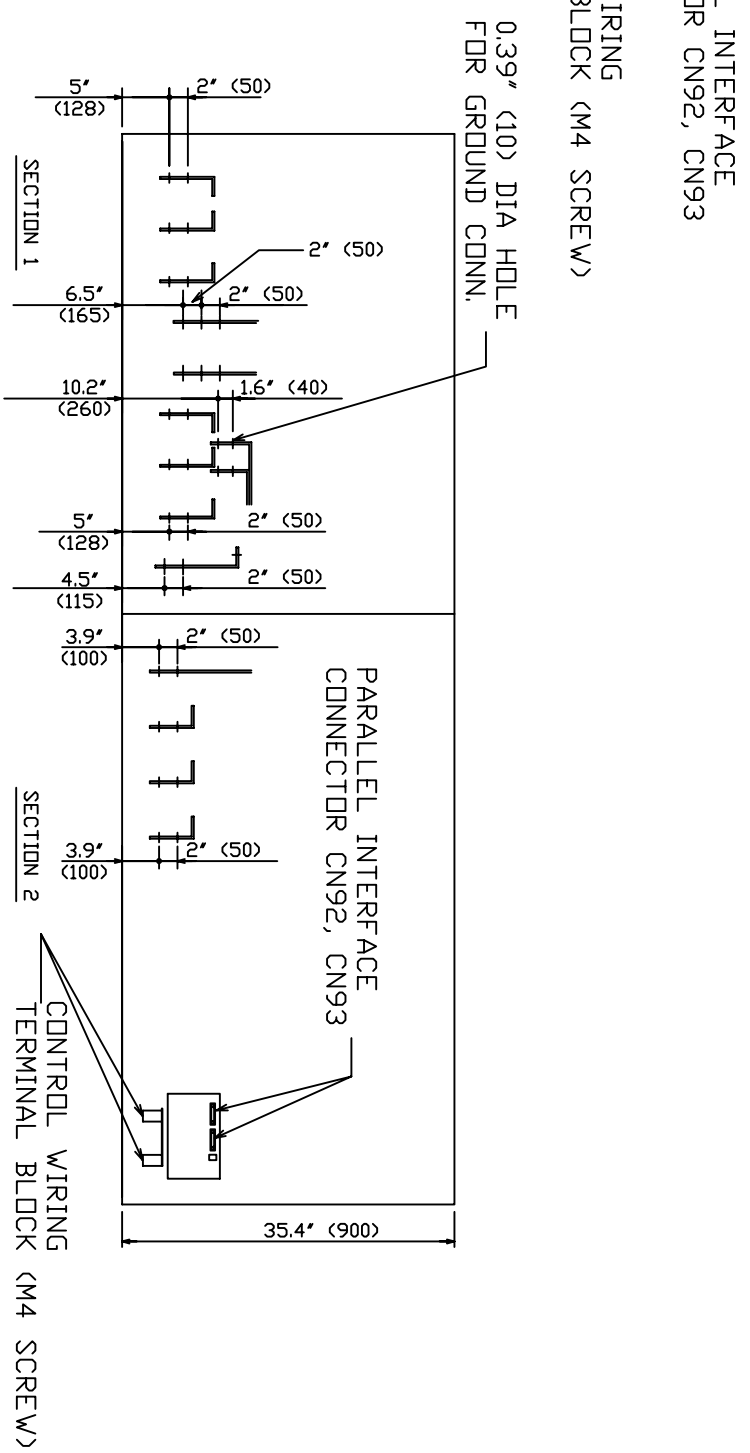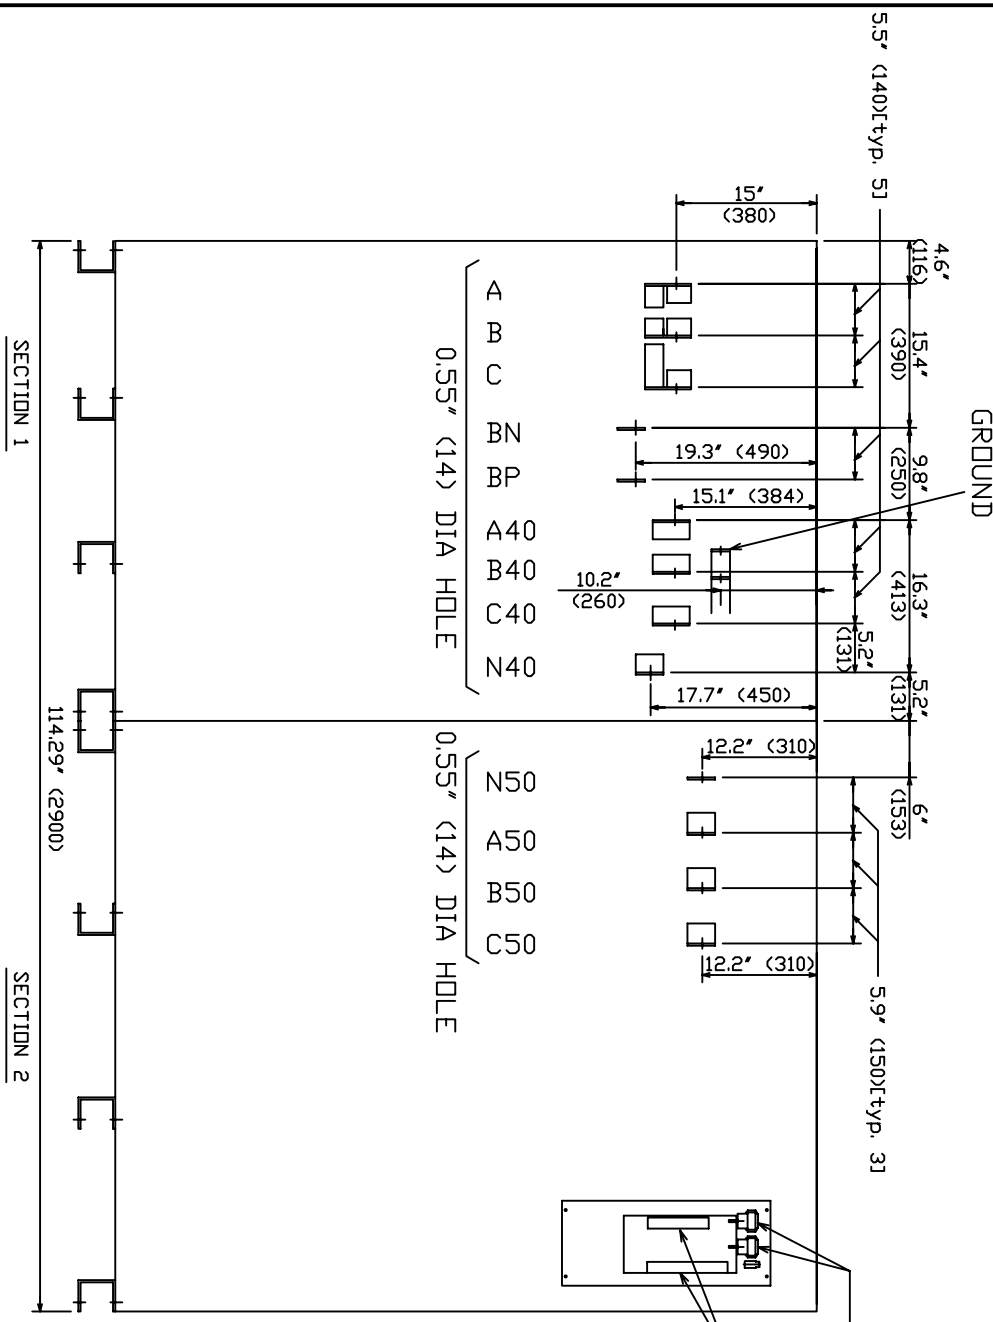

INIT RELEASE	EP0	JBT	DRAWN BY: JBT	DATE 8/27/07
			CHECKED BY	DATE
			APPROVED BY	DATE

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF TOSHIBA INTERNATIONAL CORPORATION AND SHALL NOT BE REPRODUCED, USED OR DISCLOSED TO OTHERS UNLESS PRIOR WRITTEN AUTHORIZATION IS OBTAINED.

TITLE: G8000MM UPS 500KVA
OUTLINE & INSTALLATION DRAWING

SCALE	ORDER NO.
NTS	
DRAWING NO. G8KMM500DL SH2	

TOSHIBA INTERNATIONAL CORPORATION
13131 WEST LITTLE YORK ROAD, HOUSTON, TX, 77041 U.S.A.
SH2 OF 2