


The index table below provides the associated Wilson Engineered Drawing Number for 15 UPS system configuration one-lines.


Number of Building Feeds	Internal Maintenance Bypass		External Bypass Type			VES Configuration Number
	1	2	3	2 Breaker	3 Breaker	
X	X	Yes	None	2	3 Breaker	STD-1001.0kW
X	X		X			STD-1002.0kW
X	X		X			STD-1003.0kW
X	X		X			STD-1004.0kW
X	X		X			STD-1005.0kW
X	X		X			STD-1006.0kW
X	X		X			STD-1007.0kW
X	X		X			STD-1008.0kW
X	X		X			STD-1009.0kW
X	X		X			STD-1010.0kW
X	X		X			STD-1011.0kW
X	X		X			STD-1012.0kW
X	X		X			STD-1013.0kW
X	X		X			STD-1014.0kW
X	X		X			STD-1015.0kW



VES Configuration UPS-04

- Typical UPS Configuration with:
- ☐ Single Input UPS
 - ☐ Load Input UPS
 - ☐ UPS w/ Internal Maintenance Bypass
 - ☐ Two Breaker External Bypass Point
 - ☐ Three Breaker External Bypass Point

Building Power

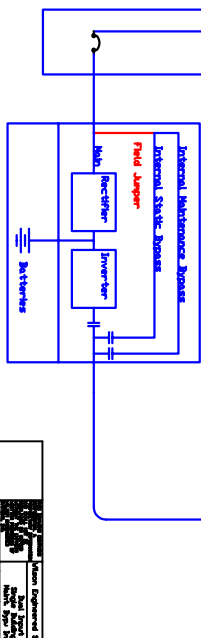


Critical Load



VES Configuration UPS-08

- Typical UPS Configuration with:
- ☐ Single Input UPS
 - ☐ Load Input UPS
 - ☐ UPS w/ Internal Maintenance Bypass
 - ☐ Two Breaker External Bypass Point
 - ☐ Three Breaker External Bypass Point

Building Power

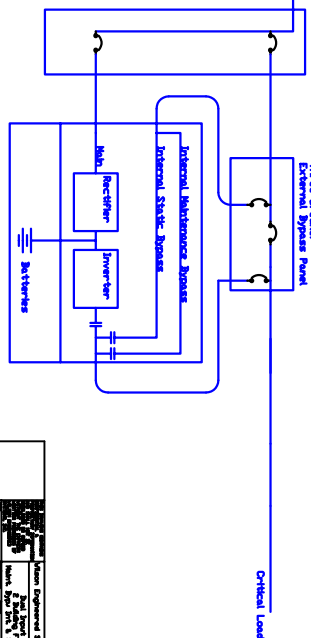


Critical Load



VES Configuration UPS-16

- Typical UPS Configuration with:
- ☐ Single Input UPS
 - ☐ Load Input UPS
 - ☐ UPS w/ Internal Maintenance Bypass
 - ☐ Two Breaker External Bypass Point
 - ☐ Three Breaker External Bypass Point

Building Power

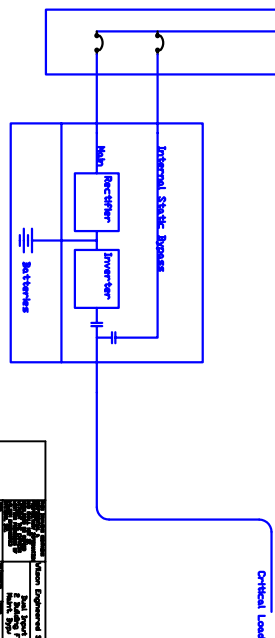


Critical Load




VES Configuration UPS-32

- Typical UPS Configuration with:
- ☐ Single Input UPS
 - ☐ Load Input UPS
 - ☐ UPS w/ Internal Maintenance Bypass
 - ☐ Two Breaker External Bypass Point
 - ☐ Three Breaker External Bypass Point

Building Power

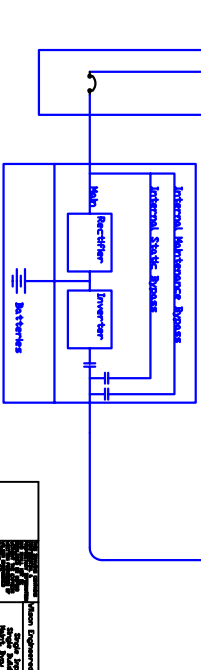


Critical Load



VES Configuration UPS-64

- Typical UPS Configuration with:
- ☐ Single Input UPS
 - ☐ Load Input UPS
 - ☐ UPS w/ Internal Maintenance Bypass
 - ☐ Two Breaker External Bypass Point
 - ☐ Three Breaker External Bypass Point

Building Power

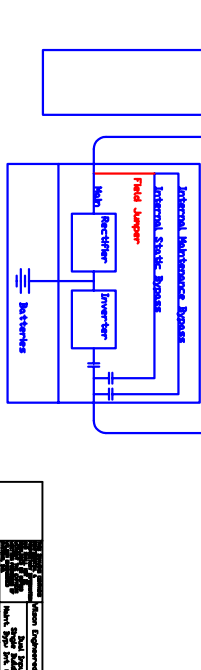


Critical Load



VES Configuration UPS-96

- Typical UPS Configuration with:
- ☐ Single Input UPS
 - ☐ Load Input UPS
 - ☐ UPS w/ Internal Maintenance Bypass
 - ☐ Two Breaker External Bypass Point
 - ☐ Three Breaker External Bypass Point

Building Power

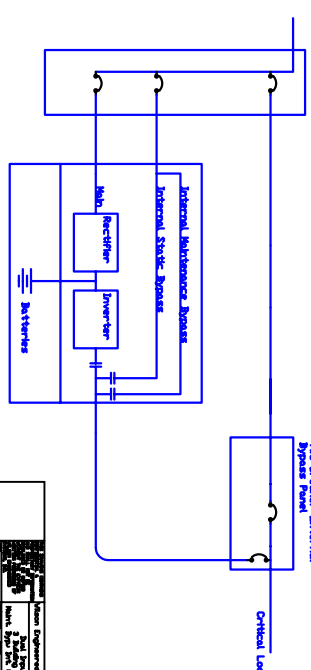


Critical Load



VES Configuration UPS-128

- Typical UPS Configuration with:
- ☐ Single Input UPS
 - ☐ Load Input UPS
 - ☐ UPS w/ Internal Maintenance Bypass
 - ☐ Two Breaker External Bypass Point
 - ☐ Three Breaker External Bypass Point

Building Power

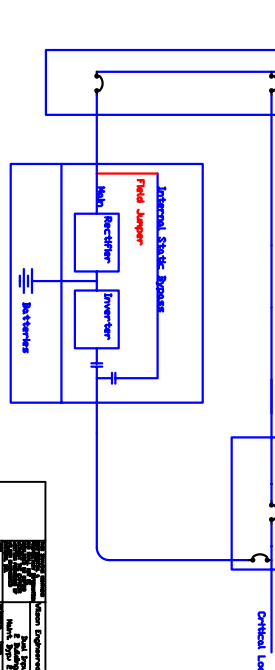


Critical Load



VES Configuration UPS-256

- Typical UPS Configuration with:
- ☐ Single Input UPS
 - ☐ Load Input UPS
 - ☐ UPS w/ Internal Maintenance Bypass
 - ☐ Two Breaker External Bypass Point
 - ☐ Three Breaker External Bypass Point

Building Power

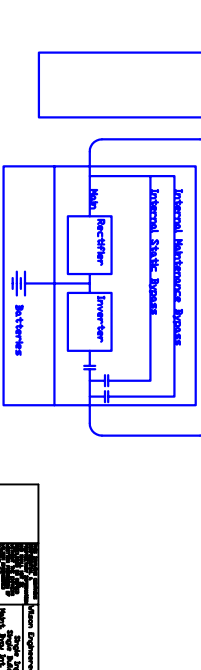


Critical Load



VES Configuration UPS-512

- Typical UPS Configuration with:
- ☐ Single Input UPS
 - ☐ Load Input UPS
 - ☐ UPS w/ Internal Maintenance Bypass
 - ☐ Two Breaker External Bypass Point
 - ☐ Three Breaker External Bypass Point

Building Power

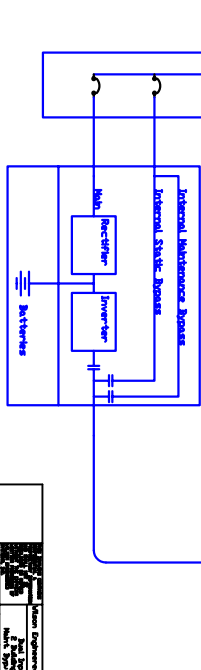


Critical Load



VES Configuration UPS-1024

- Typical UPS Configuration with:
- ☐ Single Input UPS
 - ☐ Load Input UPS
 - ☐ UPS w/ Internal Maintenance Bypass
 - ☐ Two Breaker External Bypass Point
 - ☐ Three Breaker External Bypass Point

Building Power

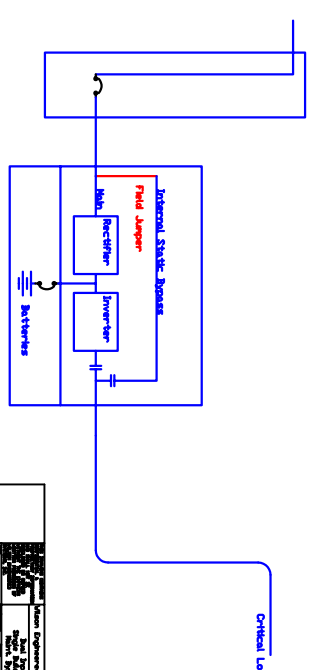


Critical Load




VES Configuration UPS-2048

- Typical UPS Configuration with:
- ☐ Single Input UPS
 - ☐ Load Input UPS
 - ☐ UPS w/ Internal Maintenance Bypass
 - ☐ Two Breaker External Bypass Point
 - ☐ Three Breaker External Bypass Point

Building Power

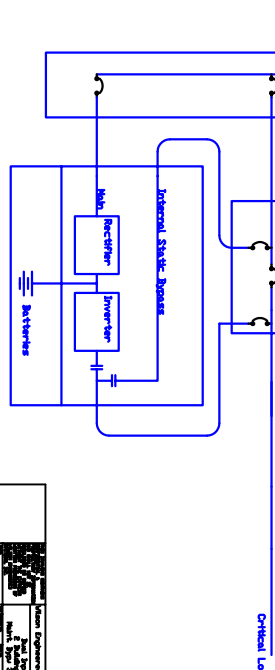


Critical Load




VES Configuration UPS-4096

- Typical UPS Configuration with:
- ☐ Single Input UPS
 - ☐ Load Input UPS
 - ☐ UPS w/ Internal Maintenance Bypass
 - ☐ Two Breaker External Bypass Point
 - ☐ Three Breaker External Bypass Point

Building Power

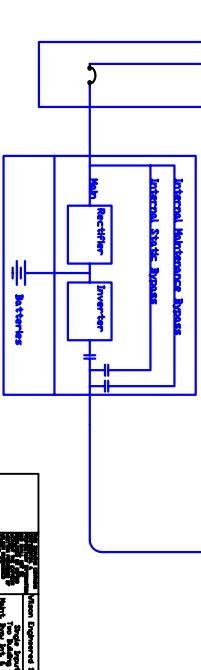


Critical Load



VES Configuration UPS-8192

- Typical UPS Configuration with:
- ☐ Single Input UPS
 - ☐ Load Input UPS
 - ☐ UPS w/ Internal Maintenance Bypass
 - ☐ Two Breaker External Bypass Point
 - ☐ Three Breaker External Bypass Point

Building Power

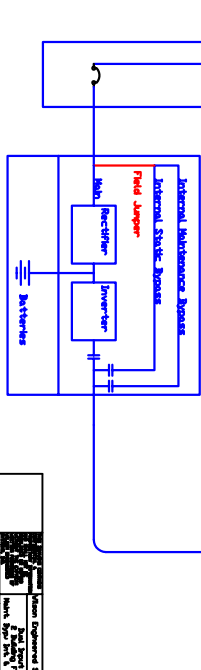


Critical Load



VES Configuration UPS-16384

- Typical UPS Configuration with:
- ☐ Single Input UPS
 - ☐ Load Input UPS
 - ☐ UPS w/ Internal Maintenance Bypass
 - ☐ Two Breaker External Bypass Point
 - ☐ Three Breaker External Bypass Point

Building Power

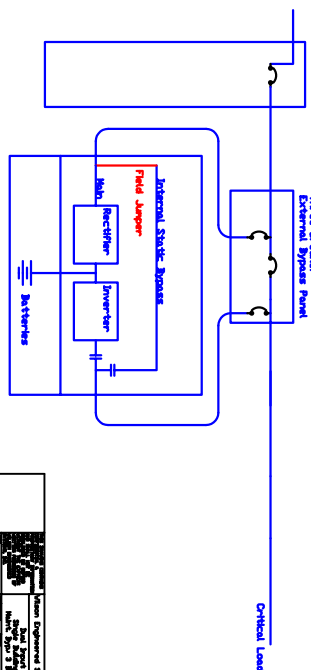


Critical Load



VES Configuration UPS-32768

- Typical UPS Configuration with:
- ☐ Single Input UPS
 - ☐ Load Input UPS
 - ☐ UPS w/ Internal Maintenance Bypass
 - ☐ Two Breaker External Bypass Point
 - ☐ Three Breaker External Bypass Point

Building Power

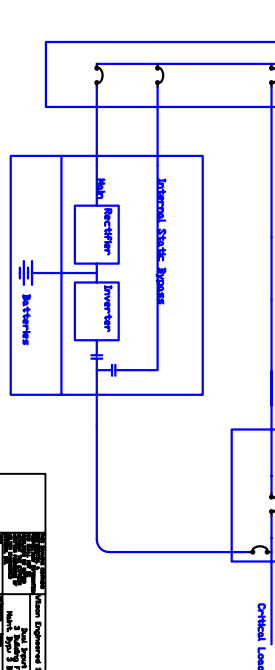

Critical Load

